


Insulation Inspection Report



OWNER'S NAME JOHN SMITH OCCUPANT JOHN SMITH DATE 0/00/00
 TREATING ADDRESS 123 MAPLE DRIVE CITY Anytown STATE US ZIP 12413
 HOME PHONE 613-243-1613 BUSINESS PHONE 613-243-1121 INSPECTED BY YOU

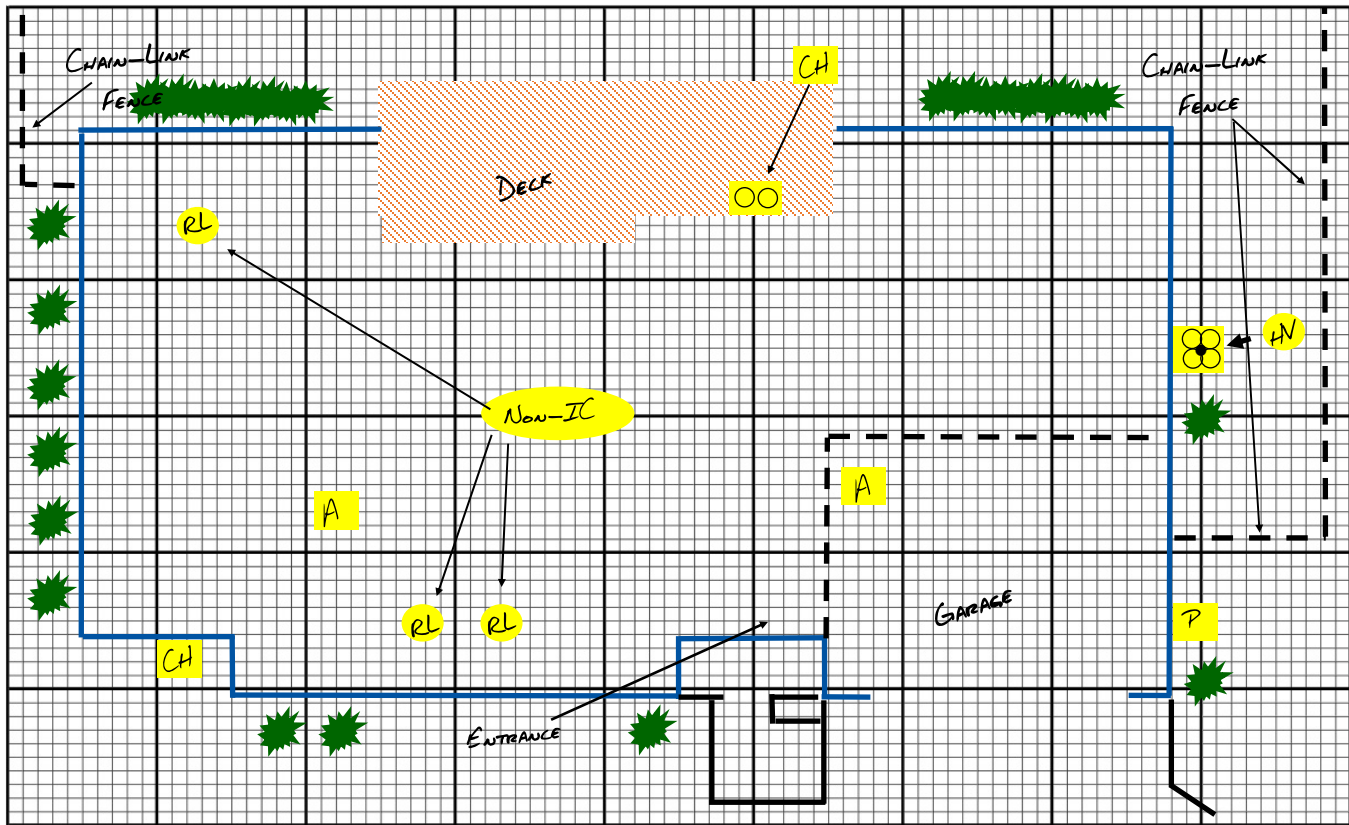

CHECK APPLICABLE SERVICE: INSTALLATION REMOVAL LOCATION: ATTIC CRAWL SPACE WALLS SUB-FLOOR
 ACCESS INSULATED: YES NO (SUGGEST ATTIC TENT) FOUNDATION STRUCTURE SLAB CRAWL BASEMENT
 INSTALL LOCATION ATTIC CRAWL WALLS SUB-FLOOR INSULATION TO INSTALL TAP® COMFORTHERM®
 LIVE TUBE & WIRING PRESENT? YES NO RECESSED LIGHTS YES NO QTY 2 CHIMNEY YES NO QTY 2
 FLUE PIPES YES NO QTY ATTIC ACCESSIBLE YES NO CLEARANCE 6 ft
 IS MOISTURE PRESENT IN INSPECTED AREAS? DESCRIBE: N/A
 CRAWL SPACE ACCESSIBLE YES NO CLEARANCE ft STATE/AGENCY CREDITS/REBATES AVAILABLE? YES NO
 ATTIC VENTS NEEDED YES NO RECOMMENDATION
 ATTIC CONSTRUCTION: STICK TRUSS RAFTER DIMENSIONS: 24" O.C. 16" O.C.
 ATTIC VENTILATION: GABLE RIDGE BOX TURBINE SOFFIT/CONTINUOUS? Yes SPACED?
 APPROX. VENTILATION SQ. FOOTAGE: 26 ADDITIONAL VENTILATION NEEDED? NO YES

NOTE LOCATIONS IN TEMPLATE ABOVE USING THIS KEY:
 CH Chimney HV HVAC System A Access RL Recessed Lights
 KN Knee Wall/Other P Power/Fuse Box IC Recessed Lights (IC Rated)

Notes:
PLEASE BE CAREFUL, DO NOT LET THE CAT OUT

| Total Sq. Footage | PRICING | Existing Insulation | Avg. Depth (Inches) | R-Value per Inch | Current R-Value | R-Value To Add | Number of Inches to Add | Quote | Additional Services | TOTAL \$ | |
|-------------------|----------|-----------------------|---------------------|------------------|-----------------|----------------|-------------------------|----------------|---------------------|----------------|----|
| <u>1,620</u> | | Fiberglass Loose-Fill | | X 2.5 = | | | | | \$ | | \$ |
| | | Fiberglass batts | <u>8"</u> | X 3.2 = | <u>26</u> | <u>23</u> | <u>6</u> | <u>\$1,920</u> | <u>N/A</u> | <u>\$1,920</u> | |
| R-Value Goal | | Cellulose Loose-Fill | | X 3.7 = | | | | \$ | | \$ | |
| <u>R-49</u> | Rockwool | | X 2.8 = | | | | \$ | | \$ | | |